
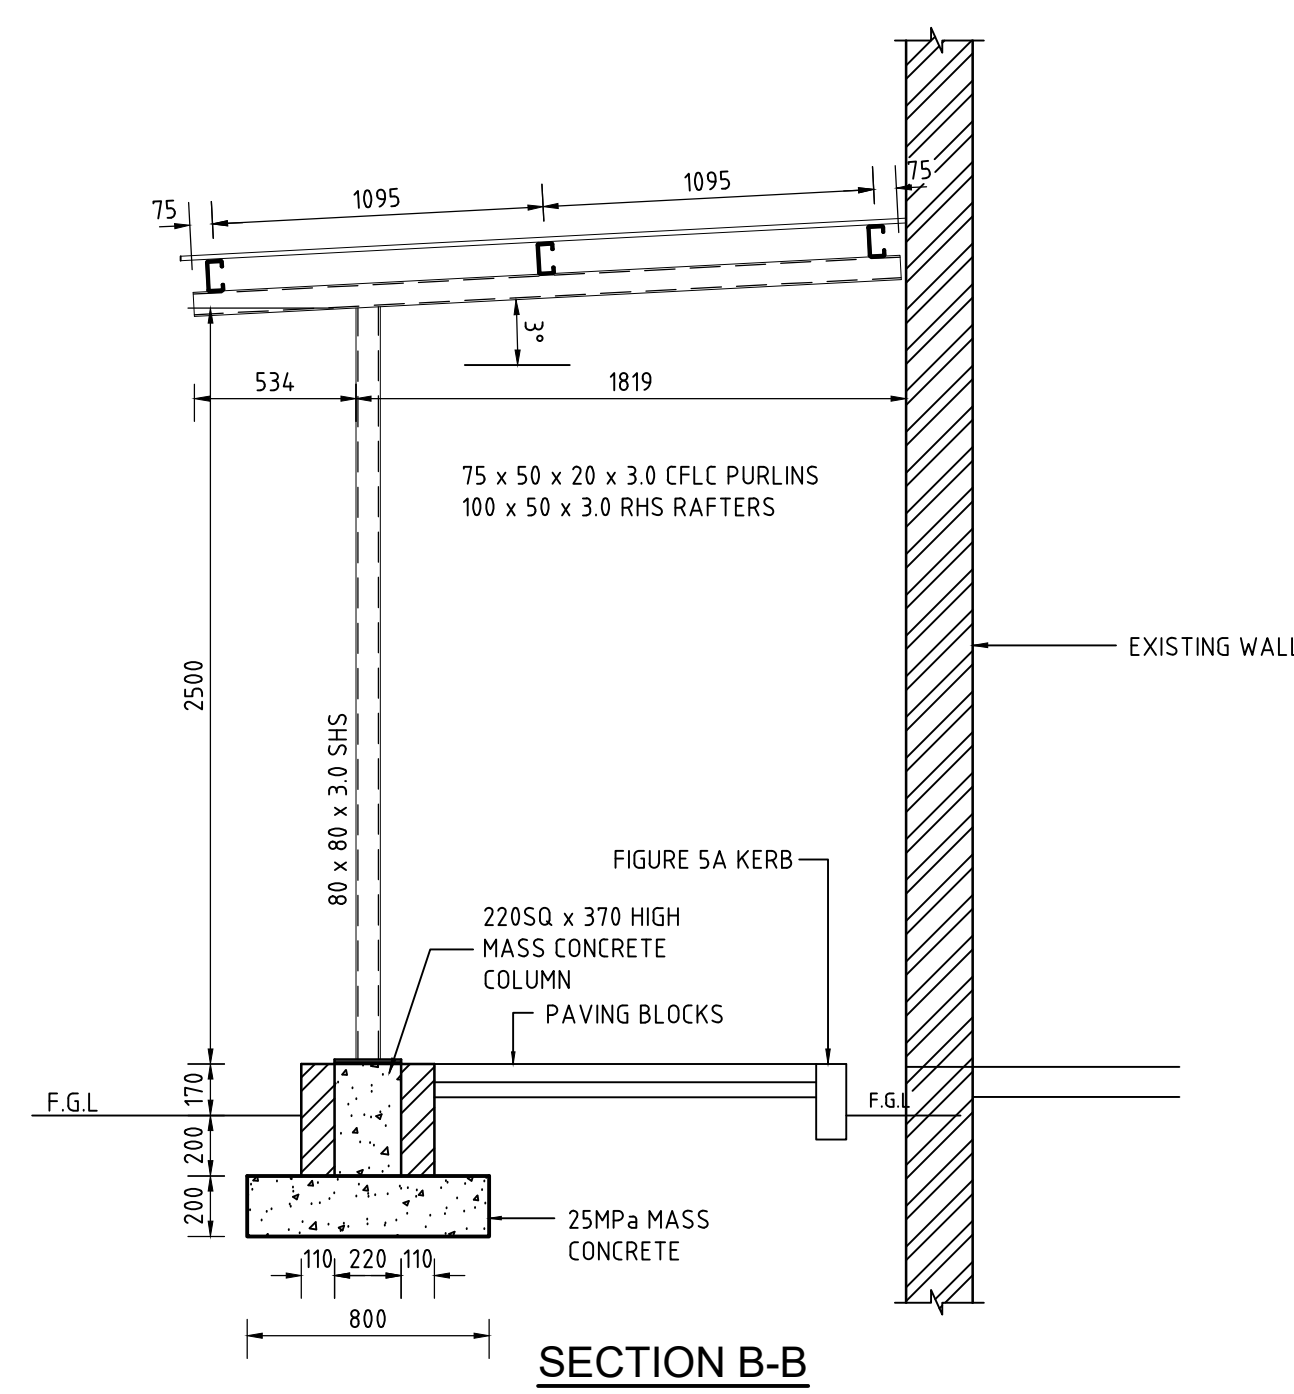


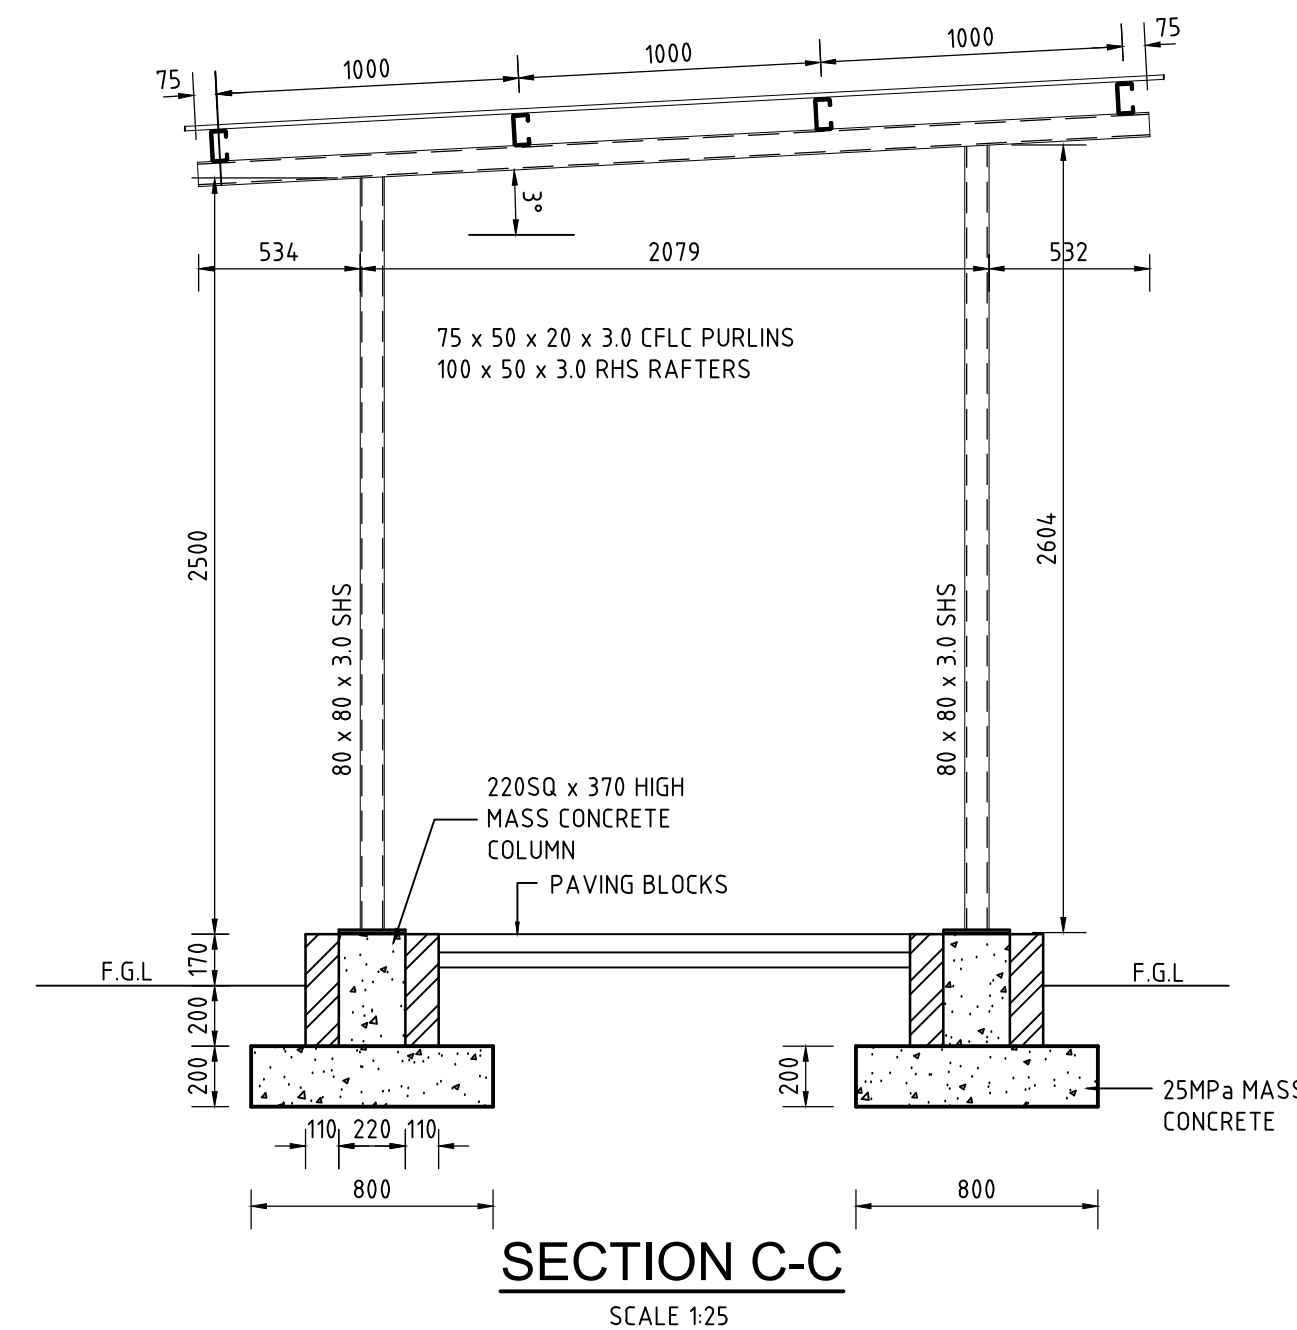

5.1 ALL LOAD BEARING BRICK WALLS ARE TO BE CONSTRUCTED OF BRICKS HAVING A MINIMUM CRUSHING STRENGTH OF 14 MPa. MORTAR IS TO BE CLASS 2 MORTAR (1:4 CEMENT:SAND BUT NOT LESS THAN 10MPa) IN ACCORDANCE WITH THE NATIONAL BUILDING REGULATIONS AND SANS 10164 UNLESS OTHERWISE NOTED.

FOR TENDER